

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400 Fax (03) 9371 2499

## **TEST REPORT**

Client :	Serfloor Australia Pty Ltd	Test Number	:	17-001317
	3/237 Princes Highway	Issue Date	:	3/04/2017
	Hallam VIC 3803	Print Date	:	5/04/2017

Sample Description	Clients Ref : "Vinyl plank Tile SF-6051"
	Colour : Grey Oak
	End Use : Flooring
	Nominal Composition : PVC
	Nominal Mass per Unit Area/Density : 8.3kg/m2
	Nominal Thickness : 5mm


## AS 4586-2013 Appendix A

## Slip Resistance Classification of new Pedestrian Surface Materials Wet Pendulum Test Method

Date of Test	31/03/2017					
Test Temperature (20±5degC)	23	°C				
Sample Preparation Washed with PH neutral detergent and dried.						
Test Direction	Length	Length				
Fixed/Unfixed					Unfixed	
Slider No 96 Batch No					67	
Length	1	2	3	4	5	SRV
British Pendulum Number	29	28	29	28	30	29
Classification					P2	1

Equipment: Cooper Pendulum Skid Tester Serial No: 1433-01 Calibrated 02/09/2015 Slider prepared using P400 and 3µm lapping film.

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance and wear on their slip resistance be checked.

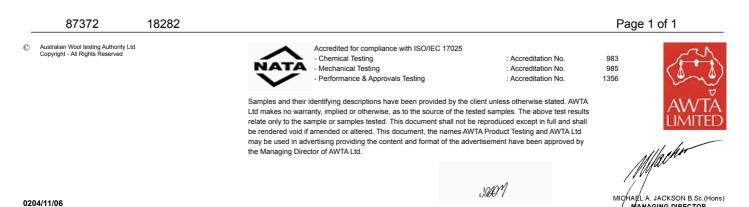

APPROVED SIGNATORY

ANAGING DIRECTOR